



October 05, 2011

Eco-Sol Ltd
Mr. Paul Allcock
Cardiff House
Cardiff Rd
Barry, Vale of Glamorgan, CF63 2AW
Great Britain

Our Reference: R27181/11CA40094

Subject: Report of Surface Burning Characteristics Tests on Samples As
Submitted By Eco-Sol Ltd

Dear Mr. Allcock:

This is a Report summarizing the results of a test conducted under a preliminary investigation identified as Assignment No. 11CA40094.

GENERAL:

Preliminary investigations are initiated to obtain information with respect to a product or products prior to submittal to Underwriters Laboratories Inc. for Investigation, Classification and Follow-Up Service. This Report does not constitute evidence of such a submittal to Underwriters Laboratories Inc. The results relate only to items tested.

METHOD:

Each test was conducted in accordance with Standard ANSI/UL723, Tenth Edition, dated September 10, 2008, "Test for Surface Burning Characteristics of Building Materials", (ASTM E84-11).

The test determines the Surface Burning Characteristics of the material, specifically the flame spread and smoke developed indices when exposed to fire.

The maximum distance the flame travels along the length of the sample from the end of the igniting flame is determined by observation. The Flame Spread Index of the material is derived by plotting the progression of the flame front on a time-distance basis, ignoring any flame front recession, and using the equations described below:

A. $CFS = 0.515 A_T$ when A_T is less than or equal to 97.5 minute-foot.

B. $CFS = 4900 / (195 - A_T)$ when A_T is greater than 97.5 minute-foot.

Where A_T = total area under the time distance curve expressed in minute-foot.

The Smoke Developed Index (SDI) is determined by rounding the Calculated Smoke Developed (CSD) as described in UL 723. The CSD is determined by the output of photoelectric equipment operating across the furnace flue pipe. A curve is developed by plotting the values of light absorption (decrease in cell output) against time. The CSD is derived by expressing the net area under the curve for the material tested as a percentage of the area under the curve for untreated red oak.

The CSD is expressed as:

$$CSD = (A_m / A_{ro}) \times 100$$

Where:

CSD = Calculated Smoke Developed

A_m = the area under the curve for the test material.

A_{ro} = the area under the curve for untreated red oak.

SAMPLES:

The samples utilized in this investigation were neither prepared nor selected by a Laboratories' representative such that no verification of composition can be provided.

Sample Description

Test No.	System
1	FLAMETECT WD (C-WD)

The fire retardant coating was applied to red oak decking. Total 3 coats per board each at 171gm were applied at minimum of 1 hour apart. Due to the rigidity of the test samples, supplementary means of support was not required.

RESULTS:

The results are tabulated below are considered applicable only to the specific samples tested.

Data sheets and graphical plots of flame travel versus time and smoke developed versus time are also enclosed.

Table 1: Test Summary

Test No.	Test Code	Sample Description	CFS Calculated Flame Spread	FSI Flame Spread Index	CSD Calculated Smoke Developed	SDI Smoke Developed Index
1	10031117	FLAMETECT WD (C-WD)	12.14	10	16.7	15

The Classification Marking of Underwriters Laboratories Inc. on the product is the only method provided by Underwriters Laboratories Inc. to identify products which have been produced under its Classification and Follow-Up Service. No use of a Classification Marking has been authorized as a result of this investigation.

Since the anticipated work has been completed, we have instructed our Accounting Department to terminate the investigation and invoice you for the charges incurred to date.

Should you have any questions, please contact the undersigned.

Very truly yours



Jamila Shawon (ext. 42607)
Senior Project Engineer
Fire Protection Division

Reviewed by:



James Smith (ext. 42666)
Staff Engineering Associate
Fire Protection Division

Project: 11CA40094
Tested by: PHILIP PASTOR

File: R27181
Engineer: JAMILA SHAWON

TestCode: 10031117
Date: 2011-10-03

TEST METHOD: The test was conducted in accordance with UL 723, Tenth Edition.

Client Name: ECO-SOL LTD

Test Duration: 10 minutes

Test No.: 1

Hot Test: No

Mounting: Other

Test Type: Developmental

Burn-Out Required: No

Test Sample: FLAMETECT WD (C-WD)

FLAME SPREAD RESULTS

Flame Spread Data

Distance (Feet)		Time (Sec)
Ignition		68
0.5		106
1		146
2		224
3		290
3.5		352
4		484
4.5		590

Calculated Flame Spread (CFS): 12.14

Flame Spread Index (FSI): 10

Time to Ignition (sec): 68

Maximum Flame Spread (ft): 4.5

Area Under the Flame Spread Curve (ft.-min.): 23.6

SMOKE RESULTS

Calculated Smoke Developed (CSD): 16.7

Smoke Developed Index (SDI): 15


Area Under the Smoke Curve (Obs-min.): 12.50

Area Under Red Oak Curve (Obs-min.): 74.67

Notes: surface char to nine feet.

Flame Spread / Smoke Results

ECO-SOL LTD
FLAMETECT WD (C-WD)

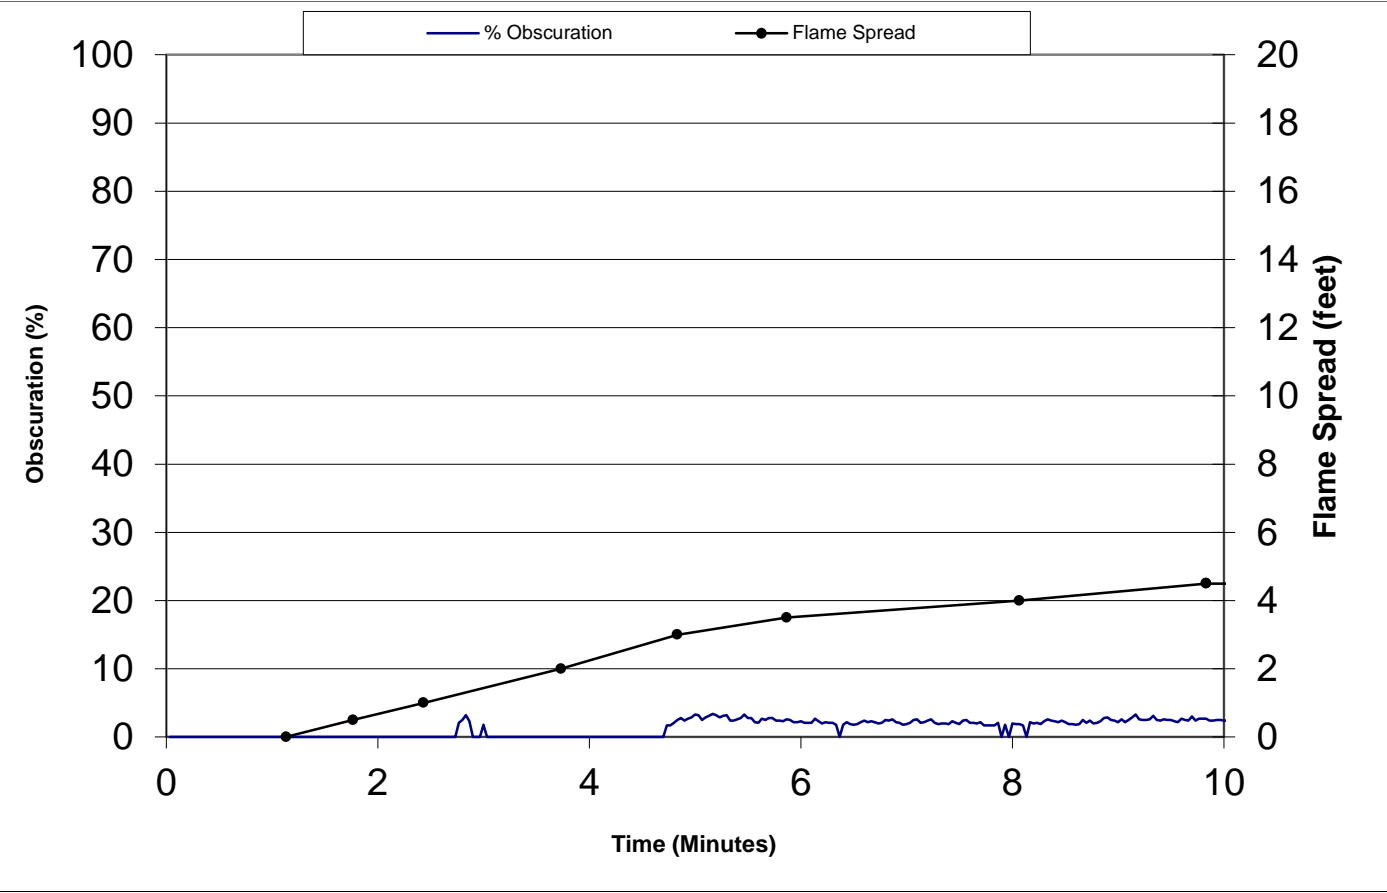

Test Num.: 1
R27181 / 11CA40094
10031117

Flame Spread Index: 10
Smoke Developed Index: 15
Max. Flame Spread (ft.): 4.5